



KΑΠΕ  
CRES

CENTER for RENEWABLE ENERGY SOURCES

---

---

## ENERGY MEASUREMENTS LABORATORY

### Test Report



KANE  
CRES  
EME  
EML

## TEST REPORT

Code Nr. : EMLF-014e  
Date of issue : 4/3/2009  
Page : 1 of 4

CONFIDENTIAL

**Center for Renewable Energy Sources**  
19th Km Marathonos Av., 190 09 Pikermi,  
Attiki  
Telephone: 210-6603300  
Fax : 210-6603305

### WARNING

*The test results relate only to the item(s) tested.  
This test report shall not be reproduced except in full without the approval of the Laboratory.*

<b>CLIENT</b>  MARIS POLYMERS S.A. Industrial area of Inofita, 320 11 Inofita, Viotia, Greece	<b>SERVICE ORDERED TO THE LABORATORY</b>  Spectral Reflectance measurements of a one component polyurethane based membrane
<b>TEST ITEM DESCRIPTION</b>  1 polyurethane based membrane specimen	<b>ITEM MANUFACTURER</b>  MARIS POLYMERS S.A.
<b>TEST ITEM IDENTIFICATION :</b>	
Mariseal 250	
<b>TEST ITEM DATE OF RECEIPT :</b>	17/02/2009
<b>ATTACHMENTS TO THIS REPORT :</b> -	
<b>REMARKS :</b> -	
<b>NAME</b>	A. Androutsopoulos
<b>TITLE</b>	Measurement responsible
<b>SIGNATURE</b>	
<b>NAME</b>	A. Androutsopoulos
<b>TITLE</b>	Head of Laboratory
<b>SIGNATURE</b>	



KAPIE  
CRES  
EME  
EML

## TEST REPORT

Code Nr. : EMLF-014e  
Date of issue : 4/3/2009  
Page : 2 of 4

### Measurement method

The measurements were carried out using the spectrophotometer UV/VIS/NIR type Lamda 19- Perkin Elmer with integrating sphere. The test specimen of a one component polyurethane based membrane Mariseal 250 (refer to Photo 1) has dimensions 4 x 4 cm and the aim of the measurements was the determination of the total spectral reflectance (%R) in the wavelength range from 400 to 2.000 nm on a 1 nm basis.

The measurement procedure is based on standard ASTM E 903-96.

The results of the measurements on a 50 nm basis are presented in the Table 1. In Figure 1, the spectral reflectance of the whole wavelength range measured is shown.

C The mean spectral reflectance of the specimen at the visual spectrum range of 500 and 750 nm is found to be: R = 91.00%.

The total uncertainty of measurement in the reported reflectivity values is estimated to be  $\pm 2\%$ .

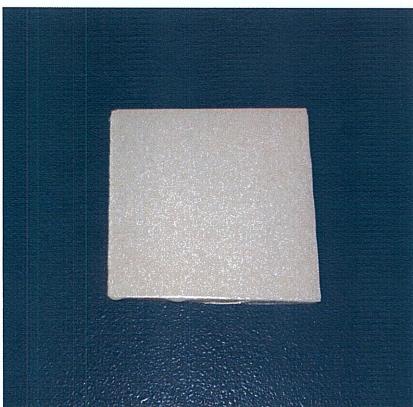


Photo 1. Measured specimen.



**KAPIE  
CRES**  
**EME**  
**EML**

**TEST REPORT**


Code Nr. : **EMLF-014e**  
Date of issue : **4/3/2009**  
Page : **3 of 4**

**Table 1.** Measurement results.

Wavelength (nm)	Spectral Reflectance (%)
	Mariseal 250
400	41.68
450	73.04
500	82.87
550	90.77
600	91.75
650	92.09
700	91.69
750	92.12
800	92.11
850	93.01
900	90.69
950	90.63
1000	89.92
1050	89.58
1100	89.51
1150	85.89
1200	82.17
1250	84.73
1300	86.97
1350	83.75
1400	76.74
1450	76.90
1500	75.61
1550	77.84
1600	77.44
1650	71.79
1700	53.12
1750	53.47
1800	56.48
1850	59.60
1900	55.71
1950	53.44
2000	51.88

<b>KATE CRES</b>	<b>TEST REPORT</b>	<b>Code Nr. : EMLF-014e</b>
<b>EME</b>	<b>Date of issue : 4/3/2009</b>	
<b>EML</b>	<b>Page : 4</b>	<b>of : 4</b>

Figure 1. Spectral reflectance of specimen Mariseal 250.

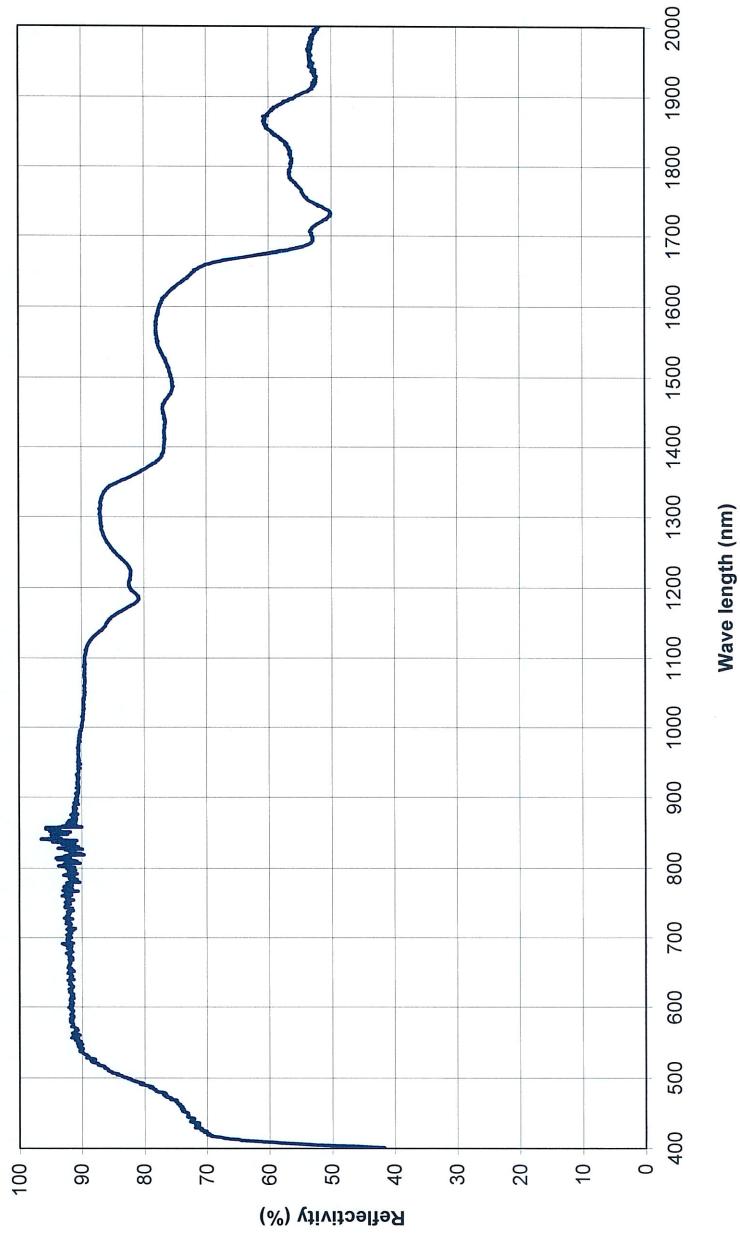

F-EML.254#01-01